



March 21, 2024

Mike Clevenger
Director of Facilities
Pleasant Hill School District
318 Cedar Street
Pleasant Hill, Missouri 64080

Project: Limited Lead in Drinking Water Testing
Address: 1 Rooster Way, Pleasant Hill, Missouri 64080

Mr. Mike Clevenger

On February 5, and February 6, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 99 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of "lead free" to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of "lead free" as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: <https://www.epa.gov/dwreginfo/lead-and-copper-rule>

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.

Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in **red text**.

February 5, and February 6, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1-1-FD	High School - Room 209- Northwest Left Sink	Sink Tap	First Draw	38.8
1-2-FD	High School - Room 209- Northwest Middle Sink	Sink Tap	First Draw	3
1-3-FD	High School - Room 209- Northwest Right Sink	Sink Tap	First Draw	0.6
1-4-FD	High School - Room 209- Northeast Sink-CW	Sink Tap	First Draw	11.9
1-5-FD	High School - Room 209- Northwest Right Sink-CW	Sink Tap	First Draw	30.1
1-6-FD	High School - Room 209- Teacher Desk Sink-CW	Sink Tap	First Draw	16.9
1-7-FD	High School - Room 209-Office Sink-CW	Sink Tap	First Draw	95.7

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1-8-FD	High School - Next to Staff Restroom-Left	Drinking Fountain	First Draw	<0.4
1-9-FD	High School - Next to Staff Restroom-Right	Drinking Fountain	First Draw	<0.4
1-10-FD	High School - Room 207- Closest to Office	Sink Tap	First Draw	62.8
1-11-FD	High School - Room 207- Second From Office	Sink Tap	First Draw	57.9
1-12-FD	High School - Room 207-Third from Office	Sink Tap	First Draw	0.9
1-13-FD	High School - Room 207- Fourth from Office	Sink Tap	First Draw	60.5
1-14-FD	High School - Room 207-Fifth From Office	Sink Tap	First Draw	58.9
1-15-	High School - Room 207- Teacher's Desk-Out of Order	Sink Tap	Not Tested	Not Sampled
1-16-FD	High School - Room 205-East Sink	Sink Tap	First Draw	0.9
1-17-FD	High School - Room 205-West Sink	Sink Tap	First Draw	1
1-18-	High School - Old Photo Lab- Out of Order	Sink Tap	Not Tested	Not Sampled
1-19-FD	High School - Room 203	Sink Tap	First Draw	1.5
1-20-FD	High School - Room 204- Northeast Sink-CW	Sink Tap	First Draw	7.8
1-21-FD	High School - Room 204- Teacher's Desk-CW	Sink Tap	First Draw	30.1
1-22-FD	High School - Room 202-Far Left	Sink Tap	First Draw	37.5
1-23-FD	High School - Room 202-Left Middle-CW	Sink Tap	First Draw	37.2
1-24-FD	High School - Room 202-Right Middle-CW	Sink Tap	First Draw	27.5
1-25-FD	High School - Room 202-Far Right-CW	Sink Tap	First Draw	54.6
1-26-FD	High School - Room 202- Teacher's Desk-CW	Sink Tap	First Draw	12.2
1-27-FD	High School - Outside PAC Balcony-Left	Drinking Fountain	First Draw	<0.4
1-28-FD	High School - Outside PAC Balcony-Right	Drinking Fountain	First Draw	<0.4
1-29-FD	High School - Wrestling Room-Right	Drinking Fountain	First Draw	<0.4
1-30-FD	High School - Food Lab-Southwest Sink	Sink Tap	First Draw	2.2
1-31-FD	High School - Food Lab-West Middle Sink	Sink Tap	First Draw	1.2
1-32-FD	High School - Food Lab-Northwest Sink	Sink Tap	First Draw	0.6
1-33-FD	High School - Food Lab-North Middle Sink	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1-34-FD	High School - Food Lab-Northeast Sink	Sink Tap	First Draw	0.4
1-35-FD	High School - Food Lab-East Middle Sink	Sink Tap	First Draw	<0.4
1-36-FD	High School - Staff Workroom	Sink Tap	First Draw	<0.4
1-37-FD	High School - Nurse's Office	Sink Tap	First Draw	<0.4
1-38-FD	High School - Nurse Office's-Restroom	Sink Tap	First Draw	<0.4
1-39-FD	High School - Front Office-Kitchenette	Sink Tap	First Draw	0.9
1-40-FD	High School - Conference Room	Sink Tap	First Draw	<0.4
1-41-FD	High School - Library Workroom	Sink Tap	First Draw	0.5
1-42-FD	High School - Hallway Outside Restrooms	Drinking Fountain	First Draw	<0.4
1-43-FD	High School - Outside Aux Gym-Left	Drinking Fountain	First Draw	<0.4
1-44-FD	High School - Outside Aux Gym-Right	Drinking Fountain	First Draw	<0.4
1-45-FD	High School - Girls Locker Room	Drinking Fountain	First Draw	<0.4
1-46-FD	High School - Girls Locker Room-Coach's Office	Sink Tap	First Draw	<0.4
1-47-FD	High School - Boys Locker Room-Coach's Office	Sink Tap	First Draw	<0.4
1-48-FD	High School - Concession Stand-Handwashing Sink	Sink Tap	First Draw	1.2
1-49-FD	High School - Concession Stand-Three Bay Sink-Left	Sink Tap	First Draw	0.6
1-50-FD	High School - Concession Stand-Three Bay Sink-Right	Sink Tap	First Draw	<0.4
1-51-FD	High School - Commons-Left	Drinking Fountain	First Draw	<0.4
1-52-FD	High School - Kitchen-North Sink	Sink Tap	First Draw	<0.4
1-53-FD	High School - Kitchen-Northwest Handwashing Sink	Sink Tap	First Draw	<0.4
1-54-FD	High School - Kitchen-Four Bay Sink-Right	Sink Tap	First Draw	<0.4
1-55-FD	High School - Kitchen-Four Bay Sink-Middle	Sink Tap	First Draw	5.7
1-56-FD	High School - Kitchen-Four Bay Sink-Left	Sink Tap	First Draw	0.7
1-57-FD	High School - Kitchen-Handwashing by Four Bay Sink	Sink Tap	First Draw	<0.4
1-58-FD	High School - Kitchen-North Middle Sink	Sink Tap	First Draw	<0.4
1-59-FD	High School - Kitchen-South Middle Sink	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1-60-FD	High School - Kitchen-Southwest Sink-Left	Sink Tap	First Draw	0.4
1-61-FD	High School - Kitchen-Southwest Middle Sink	Sink Tap	First Draw	2.8
1-62-FD	High School - Kitchen-Southwest Right Sink	Sink Tap	First Draw	0.4
1-63-FD	High School - Kitchen	Steam Kettle	First Draw	8
1-64-FD	High School - Kitchen	Pot Filler	First Draw	0.8
1-65-FD	High School - Kitchen	Pot Filler	First Draw	1.1
1-66-FD	High School - Kitchen-Serving Area	Sink Tap	First Draw	0.4
1-67-FD	High School - Kitchen-Food Warmer-East	Sink Tap	First Draw	<0.4
1-68-FD	High School - Kitchen-Food Warmer-West	Sink Tap	First Draw	0.4
1-69-FD	High School - Instrumental Music Office	Sink Tap	First Draw	26.1
1-70-FD	High School - Instrumental Music Room	Sink Tap	First Draw	<0.4
1-71-FD	High School - Instrumental Music Room	Drinking Fountain	First Draw	<0.4
1-72-FD	High School - Girls Dressing Room-Left	Sink Tap	First Draw	4.2
1-73-FD	High School - Girls Dressing Room-Right	Sink Tap	First Draw	1
1-74-FD	High School - Girls Dressing Room-Restroom	Sink Tap	First Draw	1
1-75-FD	High School - Boys Dressing Room-Left	Sink Tap	First Draw	4.7
1-76-FD	High School - Boys Dressing Room-Right	Sink Tap	First Draw	2.9
1-77-FD	High School - Boys Dressing Room-Restroom	Sink Tap	First Draw	1.2
1-78-FD	High School - Vocal Music Room	Drinking Fountain	First Draw	<0.4
1-79-FD	High School - Room 001 Lab-Northwest Sink	Sink Tap	First Draw	<0.4
1-80-FD	High School - Room 001 Lab-Northeast Sink	Sink Tap	First Draw	<0.4
1-81-FD	High School - Room 001 Lab-Southeast Sink	Sink Tap	First Draw	<0.4
1-82-FD	High School - Room 001 Lab-South Wall-Left Sink	Sink Tap	First Draw	<0.4
1-83-FD	High School - Room 001 Lab-South Wall-Right Sink	Sink Tap	First Draw	<0.4
1-84-FD	High School - Room 001 Lab-Teacher's Desk	Sink Tap	First Draw	<0.4
1-85-FD	High School - Room 001-Girls Restroom	Sink Tap	First Draw	1.7

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1-86-	High School - Room 001-Boys Restroom-No Access/Locked	Sink Tap	Not Tested	Not Sampled
1-87-FD	High School - Outside Boys Restroom	Bottle Filler	First Draw	<0.4
1-88-FD	High School - Room 002-Southeast Sink	Sink Tap	First Draw	<0.4
1-89-FD	High School - Room 002-East Middle Sink	Sink Tap	First Draw	0.4
1-90-FD	High School - Room 002-Northeast Sink	Sink Tap	First Draw	0.5
1-91-FD	High School - Room 002-Northwest Sink	Sink Tap	First Draw	0.7
1-92-FD	High School - Room 002-West Middle Sink	Sink Tap	First Draw	0.8
1-93-FD	High School - Room 002-Southwest Sink	Sink Tap	First Draw	0.8
1-94-FD	High School - Room 002-Storage Room-Left	Sink Tap	First Draw	1.7
1-95-FD	High School - Room 002-Storage Room-Right	Sink Tap	First Draw	1.6
1-96-FD	High School - Room 003 Lab	Sink Tap	First Draw	0.8
1-97-	High School - Hall by the Dock-Out of Order	Drinking Fountain	Not Tested	Not Sampled
1-98-FD	High School - Room 004	Sink Tap	First Draw	<0.4
1-99-FD	High School - Metal Shop	Drinking Fountain	First Draw	<0.4
1-100-FD	High School - Metal Shop-Men's Restroom	Sink Tap	First Draw	<0.4
1-101-FD	High School - Metal Shop-Women's Restroom	Sink Tap	First Draw	<0.4
1-102-FD	High School - Wrestling Room-Left	Drinking Fountain	First Draw	<0.4
1-103-FD	High School - Commons-Right	Drinking Fountain	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
 - The test results and a summary that explains such results;
 - A description of any remedial steps taken; and
 - A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date: 10/4/2023
Expiration Date: 10/4/2025
License Number: 211004-300006201



Paula F. Nickelson

Paula F. Nickelson
Director

Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

**STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES**

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Missouri Department of Health
and Senior Services

Lead Occupation License - ID Badge

License Number:

000801-200166567

Lead Risk Assessor

**Jeffrey
Hurst**

Expiration Date: **8/1/2024**

Paula F. Nickelson
Acting Director

Department of Health and Senior Services

Columbia, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.
- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A	WT8A	GC10ACR	GC10A	GC5A	RWM13A
------	------	---------	-------	------	--------

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

Appendix C
Laboratory Analytical Report



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

AXIOM Service Professionals

Project Name: 1 Rooster Way

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project / PO Number: 1 Rooster Way
Received: 02/09/2024
Reported: 03/18/2024

Analytical Testing Parameters

Table with 4 columns: Client Sample ID, Sample Matrix, Lab Sample ID, Collected By, Collection Date. Values include 1-1-FD, Drink Wtr, 3HB0037-01, Bradley Young, 02/05/2024 23:12.

Analyses Performed by: Microbac Laboratories, Inc., Newton

Table with 10 columns: Determination of Total Metals, Result, RL, Units, DF, Note, Prepared, Analyzed, Analyst. Row 1: 200.8, Lead, total, 38.8, 0.4, ppb, 2, 03/15/24 0824, 03/15/24 1337, RVV.

Table with 4 columns: Client Sample ID, Sample Matrix, Lab Sample ID, Collected By, Collection Date. Values include 1-2-FD, Drink Wtr, 3HB0037-02, Bradley Young, 02/05/2024 23:12.

Analyses Performed by: Microbac Laboratories, Inc., Newton

Table with 10 columns: Determination of Total Metals, Result, RL, Units, DF, Note, Prepared, Analyzed, Analyst. Row 1: 200.8, Lead, total, 3.0, 0.4, ppb, 2, 03/15/24 0824, 03/15/24 1346, RVV.

Table with 4 columns: Client Sample ID, Sample Matrix, Lab Sample ID, Collected By, Collection Date. Values include 1-3-FD, Drink Wtr, 3HB0037-03, Bradley Young, 02/05/2024 23:13.

Analyses Performed by: Microbac Laboratories, Inc., Newton

Table with 10 columns: Determination of Total Metals, Result, RL, Units, DF, Note, Prepared, Analyzed, Analyst. Row 1: 200.8, Lead, total, 0.6, 0.4, ppb, 2, 03/15/24 0824, 03/15/24 1349, RVV.

Table with 4 columns: Client Sample ID, Sample Matrix, Lab Sample ID, Collected By, Collection Date. Values include 1-4-FD, Drink Wtr, 3HB0037-04, Bradley Young, 02/05/2024 23:13.

Analyses Performed by: Microbac Laboratories, Inc., Newton

Table with 10 columns: Determination of Total Metals, Result, RL, Units, DF, Note, Prepared, Analyzed, Analyst. Row 1: 200.8, Lead, total, 11.9, 0.4, ppb, 2, 03/15/24 0824, 03/15/24 1352, RVV.



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-5-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:14
Lab Sample ID:	3HB0037-05		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	30.1	0.4	ppb	2		03/15/24 0824	03/15/24 1400	RVV

Client Sample ID:	1-6-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:14
Lab Sample ID:	3HB0037-06		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	16.9	0.4	ppb	2		03/15/24 0824	03/15/24 1403	RVV

Client Sample ID:	1-7-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:15
Lab Sample ID:	3HB0037-07		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	95.7	0.4	ppb	2		03/15/24 0824	03/15/24 1406	RVV

Client Sample ID:	1-8-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:16
Lab Sample ID:	3HB0037-08		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1409	RVV

Client Sample ID:	1-9-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:16
Lab Sample ID:	3HB0037-09		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1412	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-10-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:18
Lab Sample ID:	3HB0037-10		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	62.8	0.4	ppb	2		03/15/24 0824	03/15/24 1415	RVV

Client Sample ID:	1-11-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:19
Lab Sample ID:	3HB0037-11		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	57.9	0.4	ppb	2		03/15/24 0824	03/15/24 1418	RVV

Client Sample ID:	1-12-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:20
Lab Sample ID:	3HB0037-12		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		03/15/24 0824	03/15/24 1421	RVV

Client Sample ID:	1-13-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:20
Lab Sample ID:	3HB0037-13		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	60.5	0.4	ppb	2		03/15/24 0824	03/15/24 1424	RVV

Client Sample ID:	1-14-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:21
Lab Sample ID:	3HB0037-14		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	58.9	0.4	ppb	2		03/15/24 0824	03/15/24 1427	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-16-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:22
Lab Sample ID:	3HB0037-15		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		03/15/24 0824	03/15/24 1436	RVV

Client Sample ID:	1-17-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:22
Lab Sample ID:	3HB0037-16		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		03/15/24 0824	03/15/24 1439	RVV

Client Sample ID:	1-19-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:24
Lab Sample ID:	3HB0037-17		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.5	0.4	ppb	2		03/15/24 0824	03/15/24 1442	RVV

Client Sample ID:	1-20-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:25
Lab Sample ID:	3HB0037-18		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	7.8	0.4	ppb	2		03/15/24 0824	03/15/24 1445	RVV

Client Sample ID:	1-21-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:25
Lab Sample ID:	3HB0037-19		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	30.1	0.4	ppb	2		03/15/24 0824	03/15/24 1448	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-22-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:27
Lab Sample ID:	3HB0037-20		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	37.5	0.4	ppb	2		03/15/24 0824	03/15/24 1451	RVV

Client Sample ID:	1-23-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:27
Lab Sample ID:	3HB0037-21		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	37.2	0.4	ppb	2		03/15/24 0824	03/15/24 1500	RVV

Client Sample ID:	1-24-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:28
Lab Sample ID:	3HB0037-22		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	27.5	0.4	ppb	2		03/15/24 0824	03/15/24 1515	RVV

Client Sample ID:	1-25-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:28
Lab Sample ID:	3HB0037-23		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	54.6	0.4	ppb	2		03/15/24 0824	03/15/24 1518	RVV

Client Sample ID:	1-26-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:28
Lab Sample ID:	3HB0037-24		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	12.2	0.4	ppb	2		03/15/24 0824	03/15/24 1521	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-27-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:30
Lab Sample ID:	3HB0037-25		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1524	RVV

Client Sample ID:	1-28-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:30
Lab Sample ID:	3HB0037-26		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1527	RVV

Client Sample ID:	1-29-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:32
Lab Sample ID:	3HB0037-27		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1530	RVV

Client Sample ID:	1-30-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:34
Lab Sample ID:	3HB0037-28		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.2	0.4	ppb	2		03/15/24 0824	03/15/24 1533	RVV

Client Sample ID:	1-31-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:34
Lab Sample ID:	3HB0037-29		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		03/15/24 0824	03/15/24 1536	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-32-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:35
Lab Sample ID:	3HB0037-30		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		03/15/24 0824	03/15/24 1539	RVV

Client Sample ID:	1-33-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:35
Lab Sample ID:	3HB0037-31		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1547	RVV

Client Sample ID:	1-34-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:36
Lab Sample ID:	3HB0037-32		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1550	RVV

Client Sample ID:	1-35-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:36
Lab Sample ID:	3HB0037-33		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1553	RVV

Client Sample ID:	1-36-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:40
Lab Sample ID:	3HB0037-34		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1556	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-37-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:41
Lab Sample ID:	3HB0037-35		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1559	RVV

Client Sample ID:	1-38-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:41
Lab Sample ID:	3HB0037-36		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1602	RVV

Client Sample ID:	1-39-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:43
Lab Sample ID:	3HB0037-37		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		03/15/24 0824	03/15/24 1605	RVV

Client Sample ID:	1-40-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:43
Lab Sample ID:	3HB0037-38		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1608	RVV

Client Sample ID:	1-41-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:45
Lab Sample ID:	3HB0037-39		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/15/24 0824	03/15/24 1611	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-42-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:01
Lab Sample ID:	3HB0037-40		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1614	RVV

Client Sample ID:	1-43-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:03
Lab Sample ID:	3HB0037-41		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1629	RVV

Client Sample ID:	1-44-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:03
Lab Sample ID:	3HB0037-42		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1638	RVV

Client Sample ID:	1-45-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:05
Lab Sample ID:	3HB0037-43		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1641	RVV

Client Sample ID:	1-46-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:06
Lab Sample ID:	3HB0037-44		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1644	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-47-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:08
Lab Sample ID:	3HB0037-45		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1647	RVV

Client Sample ID:	1-48-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:10
Lab Sample ID:	3HB0037-46		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		03/15/24 0824	03/15/24 1650	RVV

Client Sample ID:	1-49-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:10
Lab Sample ID:	3HB0037-47		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		03/15/24 0824	03/15/24 1659	RVV

Client Sample ID:	1-50-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:11
Lab Sample ID:	3HB0037-48		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1702	RVV

Client Sample ID:	1-51-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:15
Lab Sample ID:	3HB0037-49		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1705	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-52-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:20
Lab Sample ID:	3HB0037-50		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1708	RVV

Client Sample ID:	1-53-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:20
Lab Sample ID:	3HB0037-51		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1711	RVV

Client Sample ID:	1-54-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:22
Lab Sample ID:	3HB0037-52		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1714	RVV

Client Sample ID:	1-55-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:22
Lab Sample ID:	3HB0037-53		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	5.7	0.4	ppb	2		03/15/24 0824	03/15/24 1717	RVV

Client Sample ID:	1-56-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:22
Lab Sample ID:	3HB0037-54		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		03/15/24 0824	03/15/24 1720	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-57-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:23
Lab Sample ID:	3HB0037-55		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1723	RVV

Client Sample ID:	1-58-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:24
Lab Sample ID:	3HB0037-56		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1726	RVV

Client Sample ID:	1-59-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:24
Lab Sample ID:	3HB0037-57		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1735	RVV

Client Sample ID:	1-60-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:26
Lab Sample ID:	3HB0037-58		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1738	RVV

Client Sample ID:	1-61-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:26
Lab Sample ID:	3HB0037-59		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.8	0.4	ppb	2		03/15/24 0824	03/15/24 1741	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-62-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:27
Lab Sample ID:	3HB0037-60		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1744	RVV

Client Sample ID:	1-63-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:29
Lab Sample ID:	3HB0037-61		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	8.0	0.4	ppb	2		03/15/24 0824	03/15/24 1753	RVV

Client Sample ID:	1-64-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:29
Lab Sample ID:	3HB0037-62		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		03/15/24 0824	03/15/24 1802	RVV

Client Sample ID:	1-65-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:30
Lab Sample ID:	3HB0037-63		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		03/15/24 0824	03/15/24 1811	RVV

Client Sample ID:	1-66-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:31
Lab Sample ID:	3HB0037-64		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1814	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-67-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:31
Lab Sample ID:	3HB0037-65		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1817	RVV

Client Sample ID:	1-68-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:32
Lab Sample ID:	3HB0037-66		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1820	RVV

Client Sample ID:	1-69-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:35
Lab Sample ID:	3HB0037-67		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	26.1	0.4	ppb	2		03/15/24 0824	03/15/24 1823	RVV

Client Sample ID:	1-70-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:36
Lab Sample ID:	3HB0037-68		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1826	RVV

Client Sample ID:	1-71-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:36
Lab Sample ID:	3HB0037-69		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1829	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-72-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:40
Lab Sample ID:	3HB0037-70		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	4.2	0.4	ppb	2		03/15/24 0824	03/15/24 1832	RVV

Client Sample ID:	1-73-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:40
Lab Sample ID:	3HB0037-71		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		03/15/24 0824	03/15/24 1835	RVV

Client Sample ID:	1-74-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:41
Lab Sample ID:	3HB0037-72		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		03/15/24 0824	03/15/24 1838	RVV

Client Sample ID:	1-75-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:42
Lab Sample ID:	3HB0037-73		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	4.7	0.4	ppb	2		03/15/24 0824	03/15/24 1847	RVV

Client Sample ID:	1-76-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:41
Lab Sample ID:	3HB0037-74		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.9	0.4	ppb	2		03/15/24 0824	03/15/24 1850	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-77-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:43
Lab Sample ID:	3HB0037-75		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		03/15/24 0824	03/15/24 1853	RVV

Client Sample ID:	1-78-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:44
Lab Sample ID:	3HB0037-76		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1856	RVV

Client Sample ID:	1-79-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:50
Lab Sample ID:	3HB0037-77		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1859	RVV

Client Sample ID:	1-80-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:50
Lab Sample ID:	3HB0037-78		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1902	RVV

Client Sample ID:	1-81-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:51
Lab Sample ID:	3HB0037-79		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1905	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-82-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:51
Lab Sample ID:	3HB0037-80		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1908	RVV

Client Sample ID:	1-83-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:52
Lab Sample ID:	3HB0037-81		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1923	RVV

Client Sample ID:	1-84-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:53
Lab Sample ID:	3HB0037-82		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1932	RVV

Client Sample ID:	1-85-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:54
Lab Sample ID:	3HB0037-83		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.7	0.4	ppb	2		03/15/24 0824	03/15/24 1935	RVV

Client Sample ID:	1-87-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:57
Lab Sample ID:	3HB0037-84		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1938	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-88-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:59
Lab Sample ID:	3HB0037-85		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1941	RVV

Client Sample ID:	1-89-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:59
Lab Sample ID:	3HB0037-86		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/15/24 0824	03/15/24 1944	RVV

Client Sample ID:	1-90-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:00
Lab Sample ID:	3HB0037-87		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/15/24 0824	03/15/24 1947	RVV

Client Sample ID:	1-91-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:01
Lab Sample ID:	3HB0037-88		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		03/15/24 0824	03/15/24 1950	RVV

Client Sample ID:	1-92-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:03
Lab Sample ID:	3HB0037-89		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		03/15/24 0824	03/15/24 1959	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-93-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:03
Lab Sample ID:	3HB0037-90		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		03/15/24 0824	03/15/24 2002	RVV

Client Sample ID:	1-94-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:04
Lab Sample ID:	3HB0037-91		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.7	0.4	ppb	2		03/15/24 0824	03/15/24 2005	RVV

Client Sample ID:	1-95-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:04
Lab Sample ID:	3HB0037-92		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.6	0.4	ppb	2		03/15/24 0824	03/15/24 2008	RVV

Client Sample ID:	1-96-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:07
Lab Sample ID:	3HB0037-93		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		03/15/24 0824	03/15/24 2011	RVV

Client Sample ID:	1-98-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:09
Lab Sample ID:	3HB0037-94		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 2014	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Client Sample ID:	1-99-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:11
Lab Sample ID:	3HB0037-95		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 2017	RVV

Client Sample ID:	1-100-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:11
Lab Sample ID:	3HB0037-96		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 2020	RVV

Client Sample ID:	1-101-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 1:12
Lab Sample ID:	3HB0037-97		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 2023	RVV

Client Sample ID:	1-102-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/05/2024 23:32
Lab Sample ID:	3HB0037-98		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 2026	RVV

Client Sample ID:	1-103-FD	Collected By:	Bradley Young
Sample Matrix:	Drink Wtr	Collection Date:	02/06/2024 0:15
Lab Sample ID:	3HB0037-99		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/15/24 0824	03/15/24 2035	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HB0037

Definitions

RL: Reporting Limit

Report Comments

*The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. **The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Reviewed and Approved By:

A handwritten signature in black ink that reads "Carolyn Jackson".

Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
03/18/24 12:03

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW: SAMPLER: <u>Bradly Young</u> SITE NAME: <u>Pleasant Hill High School</u> ADDRESS: <u>1 Rooster Way</u> CITY/ST/ZIP: <u>Pleasant Hill, Missouri 64080</u> PHONE: _____	REPORT TO: NAME: <u>Jeff Hurst</u> CO. NAME: _____ ADDRESS: <u>PO Box 47166</u> CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u> PHONE: <u>816-678-7894</u> EMAIL: <u>jeffh@axiomservicepros.com</u>		BILL TO: NAME: <u>Jeff Hurst</u> CO. NAME: _____ ADDRESS: <u>PO Box 47166</u> CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u> PHONE: <u>816-678-7894</u> EMAIL: <u>jeffh@axiomservicepros.com</u>	
--	--	--	--	--

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY			
							Lead								Wk Order #:	Sample #	
1-1-FD	2/5/2024	23:12	High School - Sink Tap - Room 209-Northwest Left Sink	1	Wt	Grab	X									3HB0037	01
1-2-FD	2/5/2024	23:12	High School - Sink Tap - Room 209-Northwest Middle Sink	1	Wt	Grab	X										02
1-3-FD	2/5/2024	23:13	High School - Sink Tap - Room 209-Northwest Right Sink	1	Wt	Grab	X										03
1-4-FD	2/5/2024	23:13	High School - Sink Tap - Room 209-Northeast Sink-CW	1	Wt	Grab	X										04
1-5-FD	2/5/2024	23:14	High School - Sink Tap - Room 209-Northwest Right Sink-CW	1	Wt	Grab	X										05
1-6-FD	2/5/2024	23:14	High School - Sink Tap - Room 209-Teacher Desk Sink-CW	1	Wt	Grab	X										06
1-7-FD	2/5/2024	23:15	High School - Sink Tap - Room 209-Office Sink-CW	1	Wt	Grab	X										07

Relinquished by: (Signature) <i>Bradly Young</i>	Date: _____ Time: _____	Received by: (Signature) <i>Vicki Burk</i>	Date: <u>2/9/24</u> Time: <u>10:00</u>	Remarks:
Relinquished by: (Signature)	Date: _____ Time: _____	Received by: (Signature)	Date: _____ Time: _____	



3 H B 0 0 3 7
AXIOM Service Professionals
PM: Carolyn Jackson

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	SAMPLER:	REPORT TO:	BILL TO:
	SITE NAME: Pleasant Hill High School	NAME: Jeff Hurst	NAME: Jeff Hurst
	ADDRESS: 1 Rooster Way	CO. NAME:	CO. NAME:
	CITY/ST/ZIP: Pleasant Hill, Missouri 64080	ADDRESS: PO Box 47166	ADDRESS: PO Box 47166
	PHONE:	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
	PHONE: 816-678-7894	PHONE: 816-678-7894	PHONE: 816-678-7894
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED										LAB USE ONLY			
							Lead												Wk Order #:	Short Hold:
																			Rush:	Temp: oC
1-16-FD	2/5/2024	23:22	High School - Sink Tap - Room 205-East Sink	1	Wt	Grab	X												15	
1-17-FD	2/5/2024	23:22	High School - Sink Tap - Room 205-West Sink	1	Wt	Grab	X												16	
1-19-FD	2/5/2024	23:24	High School - Sink Tap - Room 203	1	Wt	Grab	X												17	
1-20-FD	2/5/2024	23:25	High School - Sink Tap - Room 204-Northeast Sink-CW	1	Wt	Grab	X												18	
1-21-FD	2/5/2024	23:25	High School - Sink Tap - Room 204-Teacher Desk-CW	1	Wt	Grab	X												19	
1-22-FD	2/5/2024	23:27	High School - Sink Tap - Room 202-Far Left				X												20	
1-23-FD	2/5/2024	23:27	High School - Sink Tap - Room 202-Left Middle-CW	1	Wt	Grab	X												21	

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H B 0 0 3 7

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	SAMPLER:	REPORT TO:	BILL TO:
	SITE NAME: Pleasant Hill High School	NAME: Jeff Hurst	NAME: Jeff Hurst
	ADDRESS: 1 Rooster Way	CO. NAME:	CO. NAME:
	CITY/ST/ZIP: Pleasant Hill, Missouri 64080	ADDRESS: PO Box 47166	ADDRESS: PO Box 47166
	PHONE:	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
	PHONE: 816-678-7894	PHONE: 816-678-7894	PHONE: 816-678-7894
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED										LAB USE ONLY			
							Lead												Wk Order #:	Short Hold:
																			Rush:	Temp: oC
1-24-FD	2/5/2024	23:28	High School - Sink Tap - Room 202-Right Middle-CW	1	Wt	Grab	X												22	
1-25-FD	2/5/2024	23:28	High School - Sink Tap - Room 202-Far Right-CW	1	Wt	Grab	X												23	
1-26-FD	2/5/2024	23:28	High School - Sink Tap - Room 202-Teacher Desk-CW	1	Wt	Grab	X												24	
1-27-FD	2/5/2024	23:30	High School - Drinking Fountain - Outside PAC Balcony-Left	1	Wt	Grab	X												25	
1-28-FD	2/5/2024	23:30	High School - Drinking Fountain - Outside PAC Balcony-Right	1	Wt	Grab	X												26	
1-29-FD	2/5/2024	23:32	High School - Drinking Fountain - Wrestling Room-Right	1	Wt	Grab	X												27	
1-30-FD	2/5/2024	23:34	High School - Sink Tap - Food Lab-Southwest Sink	1	Wt	Grab	X												28	

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	



3 H B 0 0 3 7

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone
LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	SAMPLER:	REPORT TO:	BILL TO:
	SITE NAME: Pleasant Hill High School	NAME: Jeff Hurst	NAME: Jeff Hurst
	ADDRESS: 1 Rooster Way	CO. NAME:	CO. NAME:
	CITY/ST/ZIP: Pleasant Hill, Missouri 64080	ADDRESS: PO Box 47166	ADDRESS: PO Box 47166
	PHONE:	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
	PHONE: 816-678-7894	PHONE: 816-678-7894	PHONE: 816-678-7894
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY				
							Lead										Wk Order #:	Short Hold:	Rush:
1-31-FD	2/5/2024	23:34	High School - Sink Tap - Food Lab-West Middle Sink	1	Wt	Grab	X												29
1-32-FD	2/5/2024	23:35	High School - Sink Tap - Food Lab-Northwest Sink	1	Wt	Grab	X												30
1-33-FD	2/5/2024	23:35	High School - Sink Tap - Food Lab-North Middle Sink	1	Wt	Grab	X												31
1-34-FD	2/5/2024	23:36	High School - Sink Tap - Food Lab-Northeast Sink	1	Wt	Grab	X												32
1-35-FD	2/5/2024	23:36	High School - Sink Tap - Food Lab-East Middle Sink	1	Wt	Grab	X												33
1-36-FD	2/5/2024	23:40	High School - Sink Tap - Staff Workroom	1	Wt	Grab	X												34
1-37-FD	2/5/2024	23:41	High School - Sink Tap - Nurse Office	1	Wt	Grab	X												35

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H B 0 0 3 7
AXIOM Service Professionals
PM: Carolyn Jackson

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	SAMPLER:	REPORT TO:	BILL TO:
	SITE NAME: Pleasant Hill High School	NAME: Jeff Hurst	NAME: Jeff Hurst
	ADDRESS: 1 Rooster Way	CO. NAME:	CO. NAME:
	CITY/ST/ZIP: Pleasant Hill, Missouri 64080	ADDRESS: PO Box 47166	ADDRESS: PO Box 47166
	PHONE:	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
	PHONE: 816-678-7894	PHONE: 816-678-7894	PHONE: 816-678-7894
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY				
							Lead								Wk Order #:	Short Hold:	Rush:	Temp: oC
1-59-FD	2/6/2024	00:24	High School - Sink Tap - Kitchen-South Middle Sink	1	Wt	Grab	X											57
1-60-FD	2/6/2024	00:26	High School - Sink Tap - Kitchen-Southwest Sink-Left	1	Wt	Grab	X											58
1-61-FD	2/6/2024	00:26	High School - Sink Tap - Kitchen-Southwest Middle Sink	1	Wt	Grab	X											59
1-62-FD	2/6/2024	00:27	High School - Sink Tap - Kitchen-Southwest Right Sink	1	Wt	Grab	X											60
1-63-FD	2/6/2024	00:29	High School - Steam Kettle - Kitchen	1	Wt	Grab	X											61
1-64-FD	2/6/2024	00:29	High School - Pot Filler - Kitchen	1	Wt	Grab	X											62
1-65-FD	2/6/2024	00:30	High School - Pot Filler - Kitchen	1	Wt	Grab	X											63

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	



AXIOM Service Professionals
PM: Carolyn Jackson

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	SAMPLER:	REPORT TO:	BILL TO:
	SITE NAME: Pleasant Hill High School	NAME: Jeff Hurst	NAME: Jeff Hurst
	ADDRESS: 1 Rooster Way	CO. NAME:	CO. NAME:
	CITY/ST/ZIP: Pleasant Hill, Missouri 64080	ADDRESS: PO Box 47166	ADDRESS: PO Box 47166
	PHONE:	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
	PHONE: 816-678-7894	PHONE: 816-678-7894	PHONE: 816-678-7894
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY				
							Lead								Wk Order #:	Short Hold:	Rush:	Temp: oC
1-73-FD	2/6/2024	00:40	High School - Sink Tap - Girls Dressing Room-Right	1	Wt	Grab	X											71
1-74-FD	2/6/2024	00:41	High School - Sink Tap - Girls Dressing Room-Bathroom	1	Wt	Grab	X											72
1-75-FD	2/6/2024	00:42	High School - Sink Tap - Boys Dressing Room-Left	1	Wt	Grab	X											73
1-76-FD	2/6/2024	00:41	High School - Sink Tap - Boys Dressing Room-Right	1	Wt	Grab	X											74
1-77-FD	2/6/2024	00:43	High School - Sink Tap - Boys Dressing Room-Bathroom	1	Wt	Grab	X											75
1-78-FD	2/6/2024	00:44	High School - Drinking Fountain - Vocal Music Room	1	Wt	Grab	X											76
1-79-FD	2/6/2024	00:50	High School - Sink Tap - Room 001 Lab-Northwest Sink	1	Wt	Grab	X											77

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	



3 H B 0 0 3 7
AXIOM Service Professionals
PM: Carolyn Jackson

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansbrough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	SAMPLER:	REPORT TO:	BILL TO:
	SITE NAME: Pleasant Hill High School	NAME: Jeff Hurst	NAME: Jeff Hurst
	ADDRESS: 1 Rooster Way	CO. NAME:	CO. NAME:
	CITY/ST/ZIP: Pleasant Hill, Missouri 64080	ADDRESS: PO Box 47166	ADDRESS: PO Box 47166
	PHONE:	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
	PHONE: 816-678-7894	PHONE: 816-678-7894	PHONE: 816-678-7894
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY				
							Lead									Wk Order #:	Short Hold:	Rush:
1-80-FD	2/6/2024	00:50	High School - Sink Tap - Room 001 Lab-Northeast Sink	1	Wt	Grab	X											78
1-81-FD	2/6/2024	00:51	High School - Sink Tap - Room 001 Lab-Southeast Sink	1	Wt	Grab	X											79
1-82-FD	2/6/2024	00:51	High School - Sink Tap - Room 001 Lab-South Wall-Left Sink	1	Wt	Grab	X											80
1-83-FD	2/6/2024	00:52	High School - Sink Tap - Room 001 Lab-South Wall-Right Sink	1	Wt	Grab	X											81
1-84-FD	2/6/2024	00:53	High School - Sink Tap - Room 001 Lab-Teacher Desk	1	Wt	Grab	X											82
1-85-FD	2/6/2024	00:54	High School - Sink Tap - Room 001-Girls Bathroom	1	Wt	Grab	X											83
1-87-FD	2/6/2024	00:57	High School - Bottle Filler - Outside Boys Bathroom	1	Wt	Grab	X											84

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H B 0 0 3 7

AXIOM Service Professionals

PM: Carolyn Jackson

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	SAMPLER:	REPORT TO:	BILL TO:
	SITE NAME: Pleasant Hill High School	NAME: Jeff Hurst	NAME: Jeff Hurst
	ADDRESS: 1 Rooster Way	CO. NAME:	CO. NAME:
	CITY/ST/ZIP: Pleasant Hill, Missouri 64080	ADDRESS: PO Box 47166	ADDRESS: PO Box 47166
	PHONE:	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
	PHONE: 816-678-7894	PHONE: 816-678-7894	PHONE: 816-678-7894
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME	# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED										LAB USE ONLY			
						Lead												Wk Order #:	Short Hold:
																		Rush:	Temp: oC
1-88-FD	2/6/2024	00:59	1	Wt	Grab	X												85	
1-89-FD	2/6/2024	00:59	1	Wt	Grab	X												86	
1-90-FD	2/6/2024	01:00	1	Wt	Grab	X												87	
1-91-FD	2/6/2024	01:01	1	Wt	Grab	X												88	
1-92-FD	2/6/2024	01:03	1	Wt	Grab	X												89	
1-93-FD	2/6/2024	01:03	1	Wt	Grab	X												90	
1-94-FD	2/6/2024	01:04	1	Wt	Grab	X												91	

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
	Time:		Time:	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
	Time:		Time:	



3 H B 0 0 3 7
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone
LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440



835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	SAMPLER:	REPORT TO:	BILL TO:
	SITE NAME: Pleasant Hill High School	NAME: Jeff Hurst	NAME: Jeff Hurst
	ADDRESS: 1 Rooster Way	CO. NAME:	CO. NAME:
	CITY/ST/ZIP: Pleasant Hill, Missouri 64080	ADDRESS: PO Box 47166	ADDRESS: PO Box 47166
	PHONE:	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
	PHONE: 816-678-7894	PHONE: 816-678-7894	
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com	

CLIENT SAMPLE #	DATE	TIME	# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED										LAB USE ONLY																																																																																																													
							1	2	3	4	5	6	7	8	9	10	11	12	Wk Order #:	Short Hold:																																																																																																										
1-103-FD	2/6/2024	00:15	1	Wt	Grab	X																																																																																																																								

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
<i>Bradley</i>				
Time:		Time:		
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
Time:		Time:		



3 H B 0 0 3 7
AXIOM Service Professionals
PM: Carolyn Jackson

Appendix D Photo Log



2/5/2024 - 1-1 - High School - Room 209-
Northwest Left Sink



2/5/2024 - 1-2 - High School - Room 209-
Northwest Middle Sink




2/5/2024 - 1-3 - High School - Room 209-
Northwest Right Sink



2/5/2024 - 1-4 - High School - Room 209-
Northeast Sink-CW



2/5/2024 - 1-5 - High School - Room 209-
Northwest Right Sink-CW

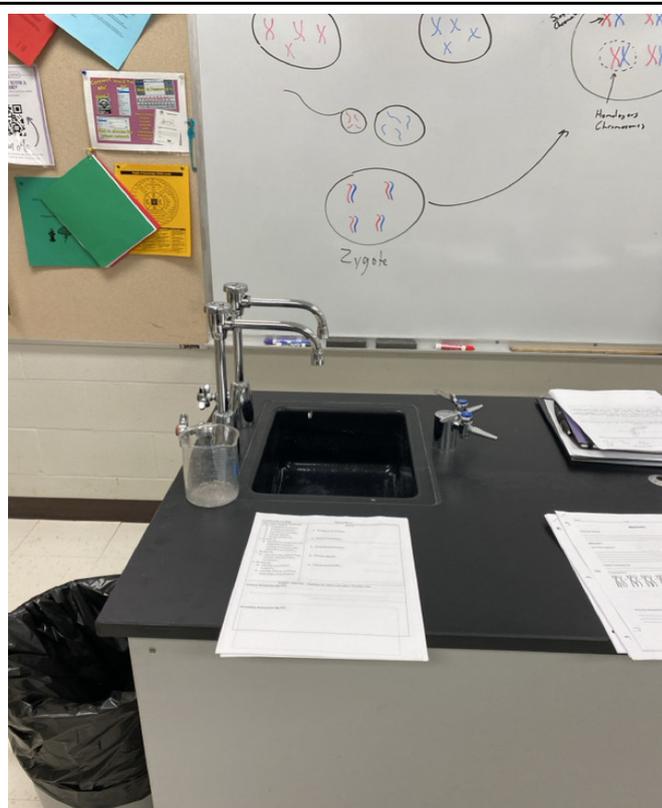


2/5/2024 - 1-6 - High School - Room 209-Teacher
Desk Sink-CW



2/5/2024 - 1-7 - High School - Room 209-Office
Sink-CW




2/5/2024 - 1-8 - High School - Next to Staff
Restroom-Left

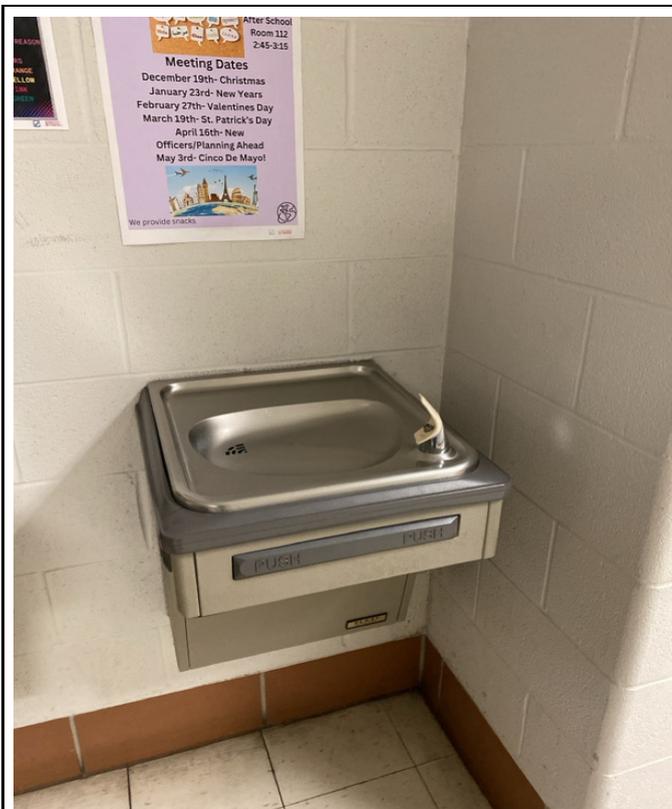


2/5/2024 - 1-9 - High School - Next to Staff Restroom-Right



2/5/2024 - 1-10 - High School - Room 207-Closest to Office

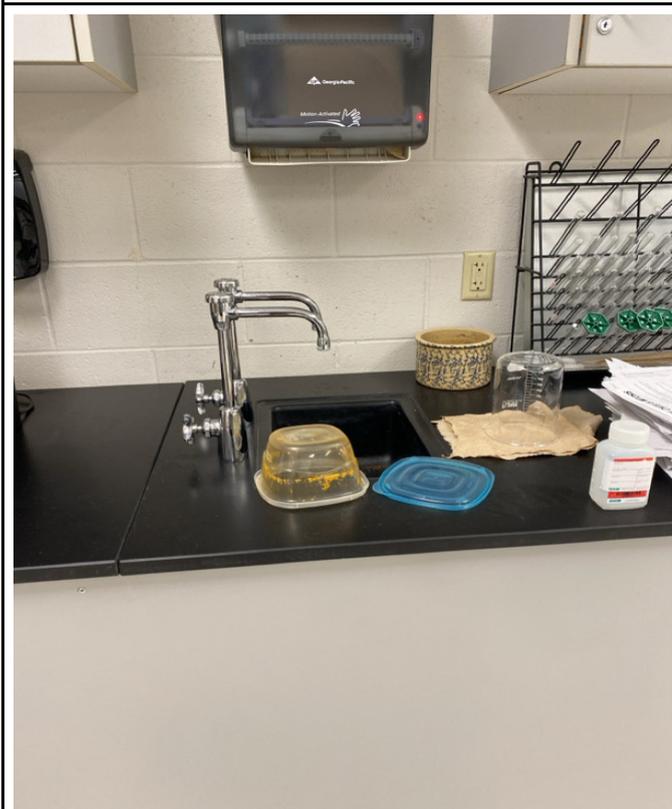


2/5/2024 - 1-11 - High School - Room 207-Second From Office

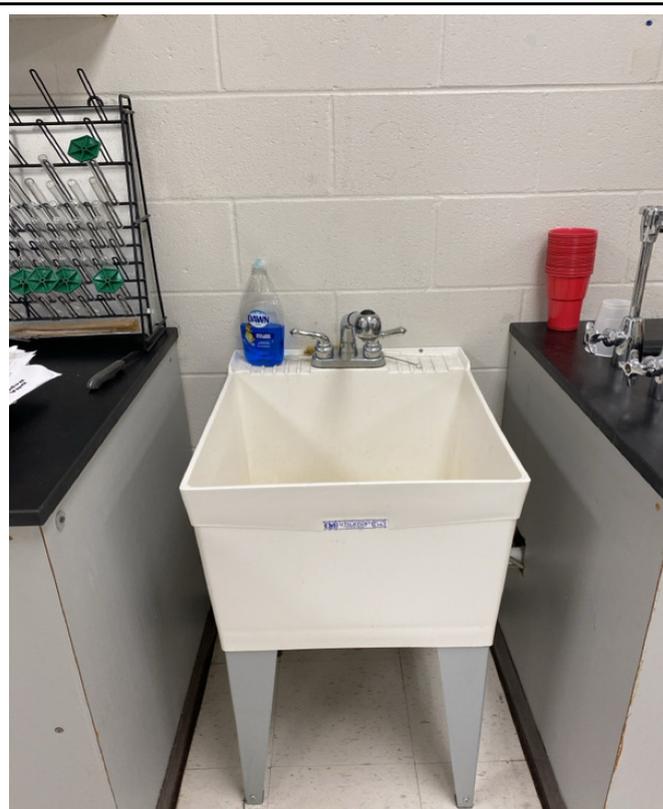


2/5/2024 - 1-12 - High School - Room 207-Third from Office




2/5/2024 - 1-13 - High School - Room 207-Fourth from Office

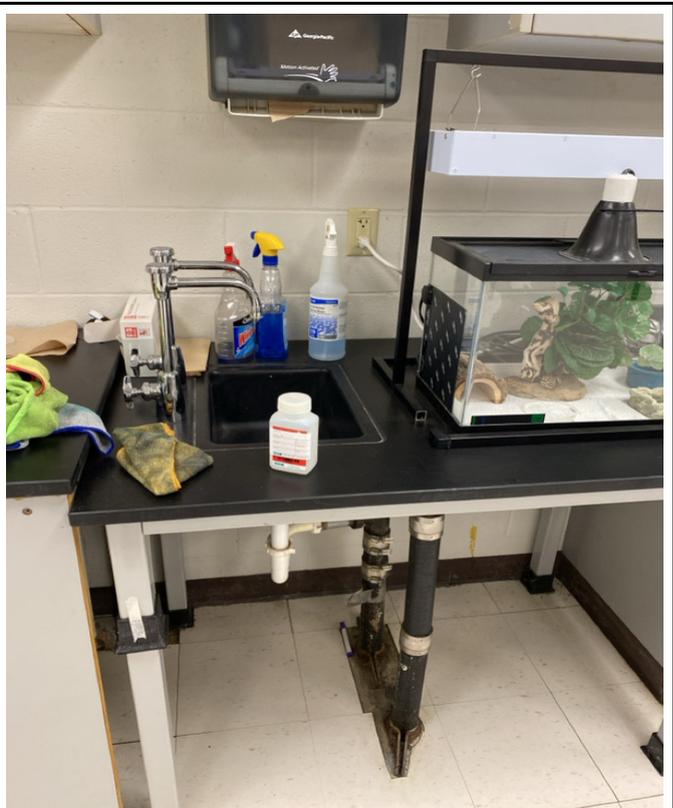

2/5/2024 - 1-14 - High School - Room 207-Fifth From Office

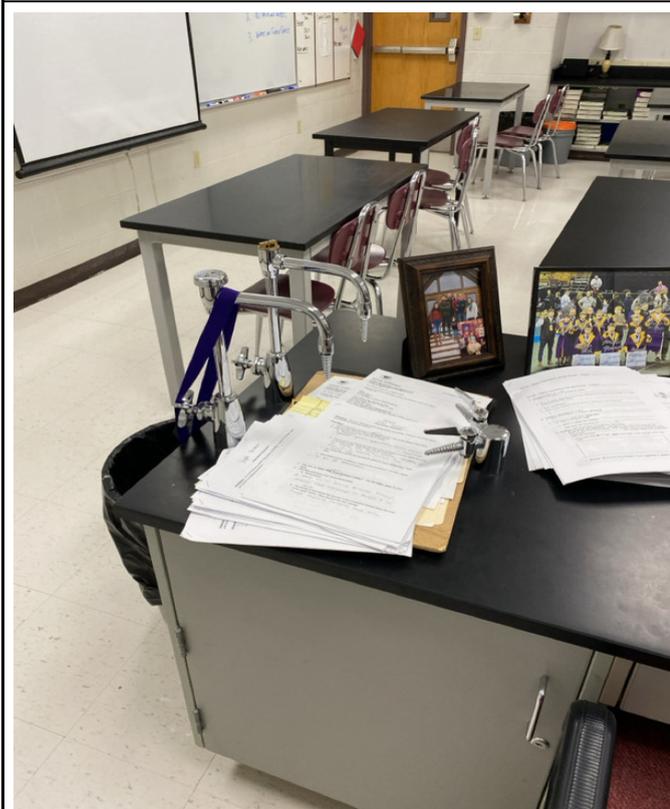

2/5/2024 - 1-15 - High School - Room 207-Teacher's Desk-Out of Order

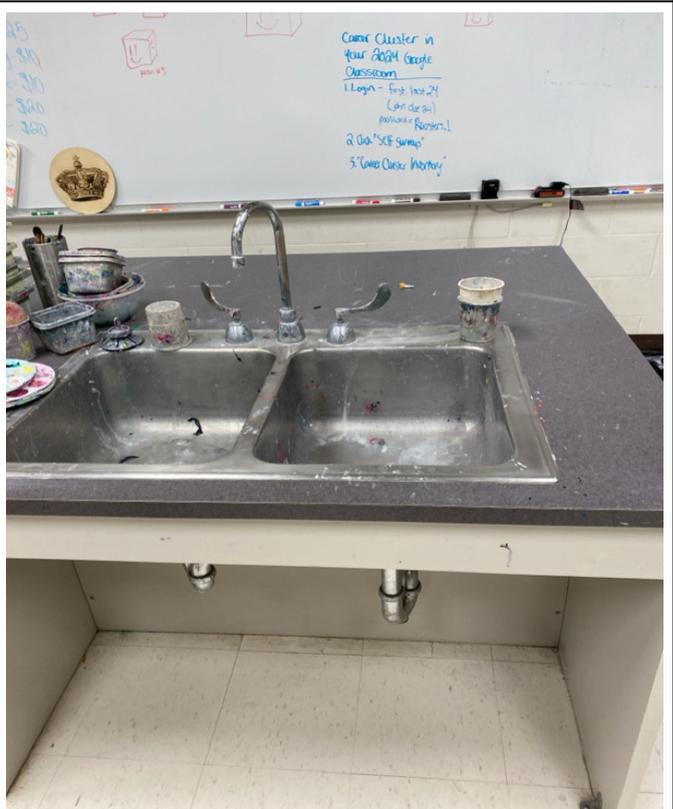

2/5/2024 - 1-16 - High School - Room 205-East Sink



2/5/2024 - 1-17 - High School - Room 205-West Sink




2/5/2024 - 1-18 - High School - Old Photo Lab-Out of Order




2/5/2024 - 1-19 - High School - Room 203




2/5/2024 - 1-20 - High School - Room 204-Northeast Sink-CW

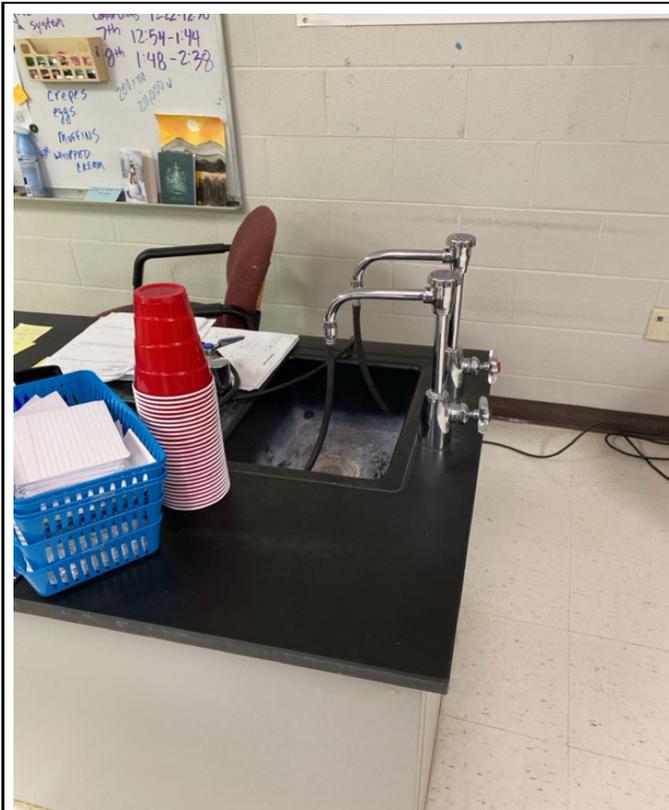

2/5/2024 - 1-21 - High School - Room 204-
Teacher's Desk-CW

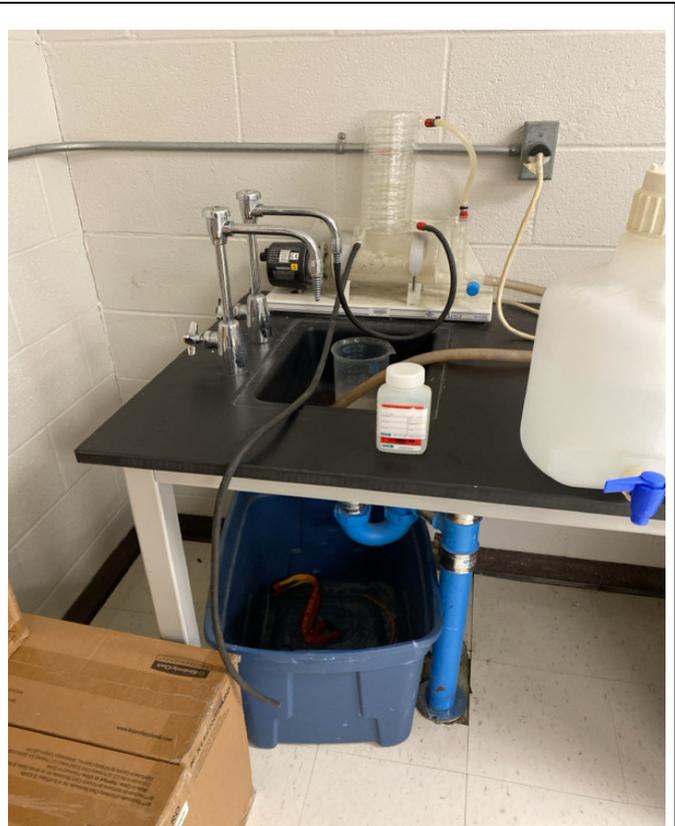


2/5/2024 - 1-22 - High School - Room 202-Far Left

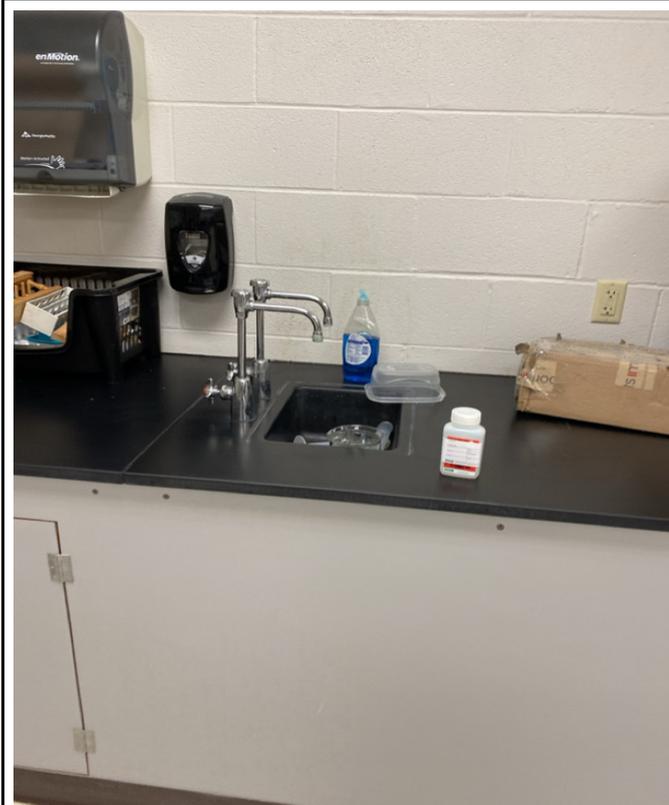


2/5/2024 - 1-23 - High School - Room 202-Left
Middle-CW



2/5/2024 - 1-24 - High School - Room 202-Right
Middle-CW

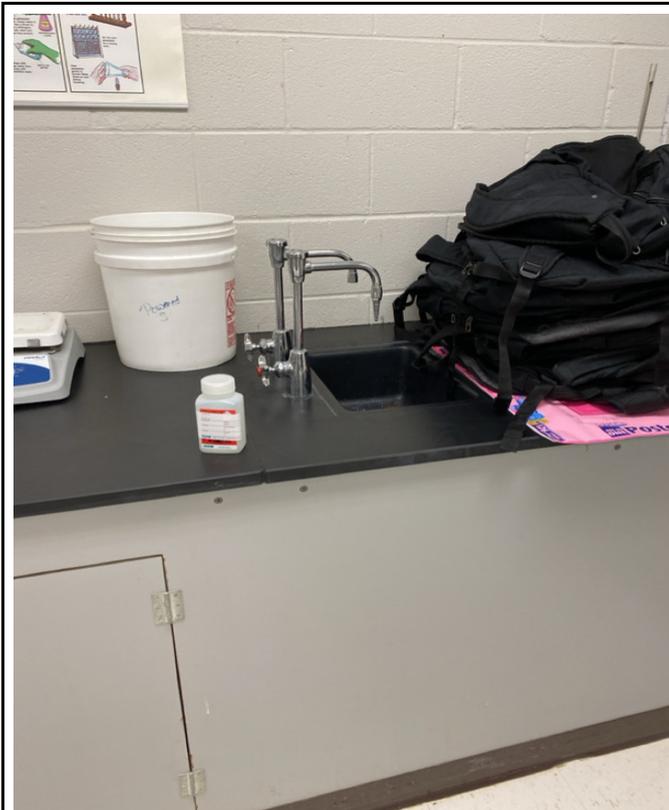


2/5/2024 - 1-25 - High School - Room 202-Far Right-CW

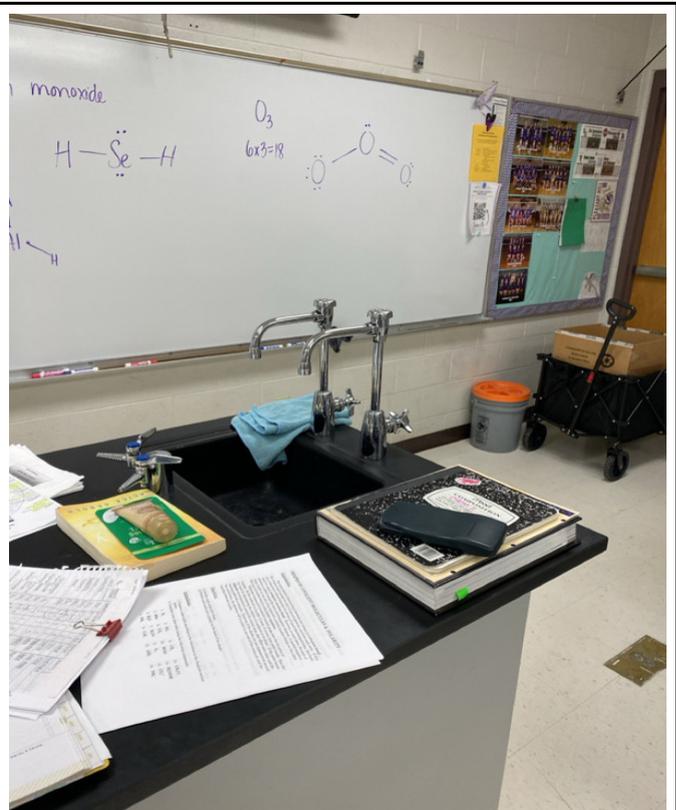

2/5/2024 - 1-26 - High School - Room 202-Teacher's Desk-CW



2/5/2024 - 1-27 - High School - Outside PAC Balcony-Left

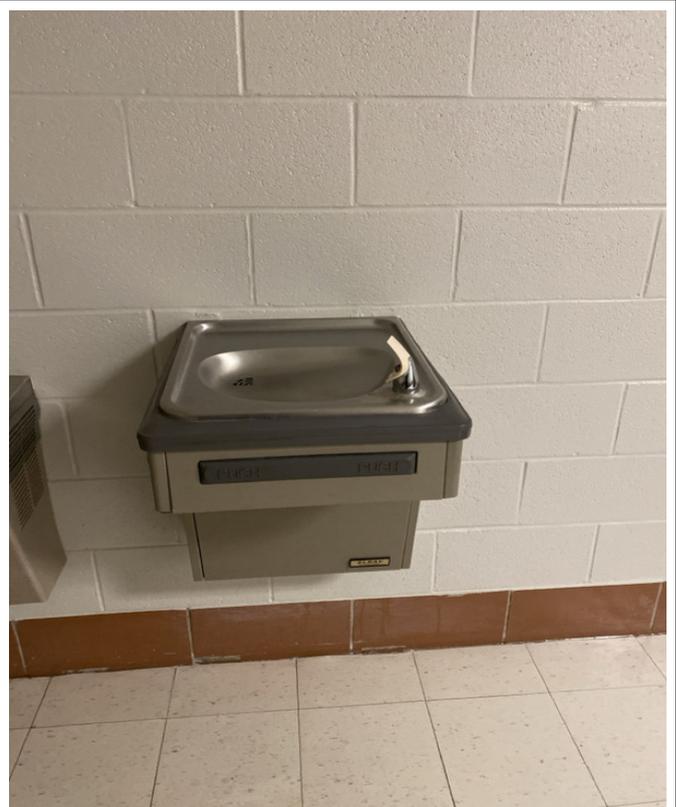

2/5/2024 - 1-28 - High School - Outside PAC Balcony-Right



2/5/2024 - 1-29 - High School - Wrestling Room-
Right




2/5/2024 - 1-30 - High School - Food Lab-
Southwest Sink



2/5/2024 - 1-31 - High School - Food Lab-West
Middle Sink



2/5/2024 - 1-32 - High School - Food Lab-
Northwest Sink

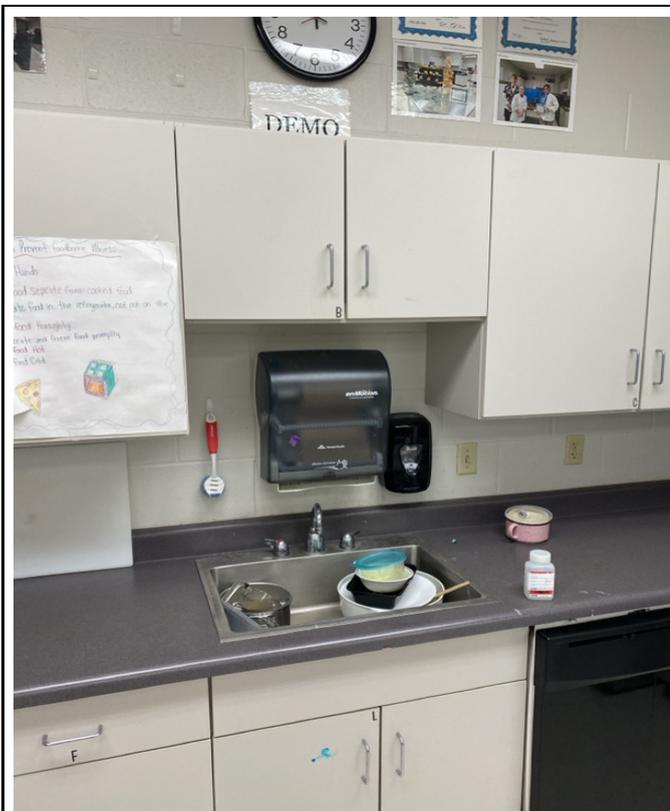

2/5/2024 - 1-33 - High School - Food Lab-North Middle Sink



2/5/2024 - 1-34 - High School - Food Lab-Northeast Sink



2/5/2024 - 1-35 - High School - Food Lab-East Middle Sink



2/5/2024 - 1-36 - High School - Staff Workroom




2/5/2024 - 1-37 - High School - Nurse's Office




2/5/2024 - 1-38 - High School - Nurse Office's Restroom



2/5/2024 - 1-39 - High School - Front Office-Kitchenette

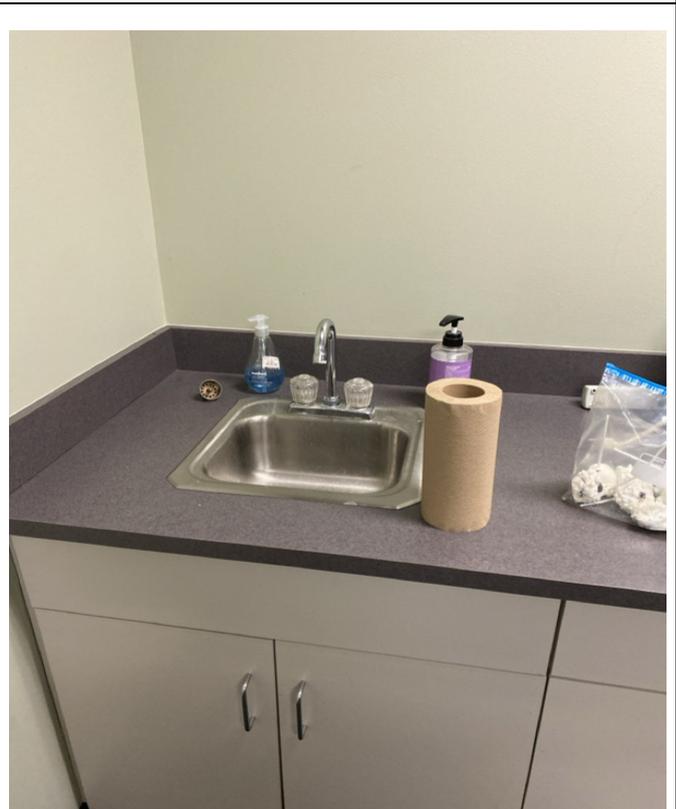

2/5/2024 - 1-40 - High School - Conference Room

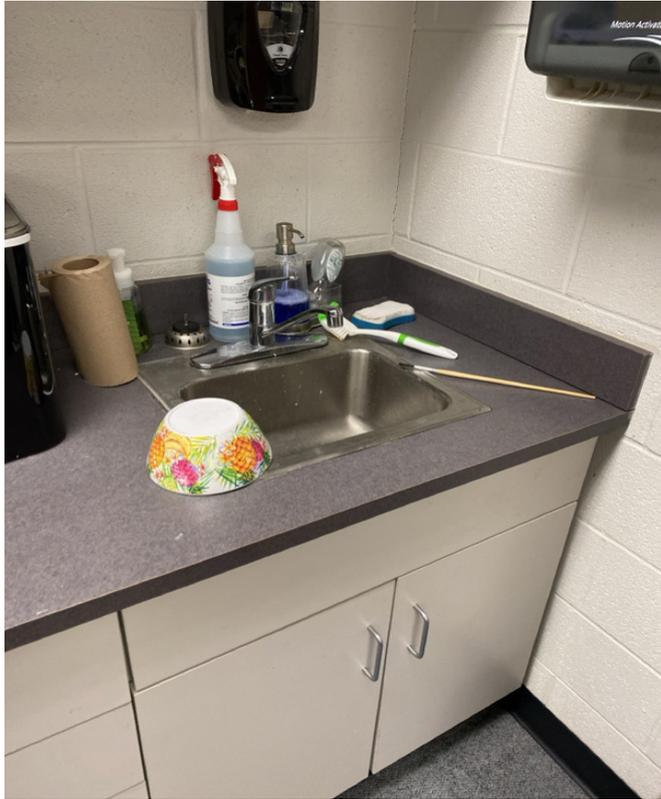

2/5/2024 - 1-41 - High School - Library Workroom



2/6/2024 - 1-42 - High School - Hallway Outside Restrooms




2/6/2024 - 1-43 - High School - Outside Aux Gym-Left




2/6/2024 - 1-44 - High School - Outside Aux Gym-Right



2/6/2024 - 1-45 - High School - Girls Locker Room

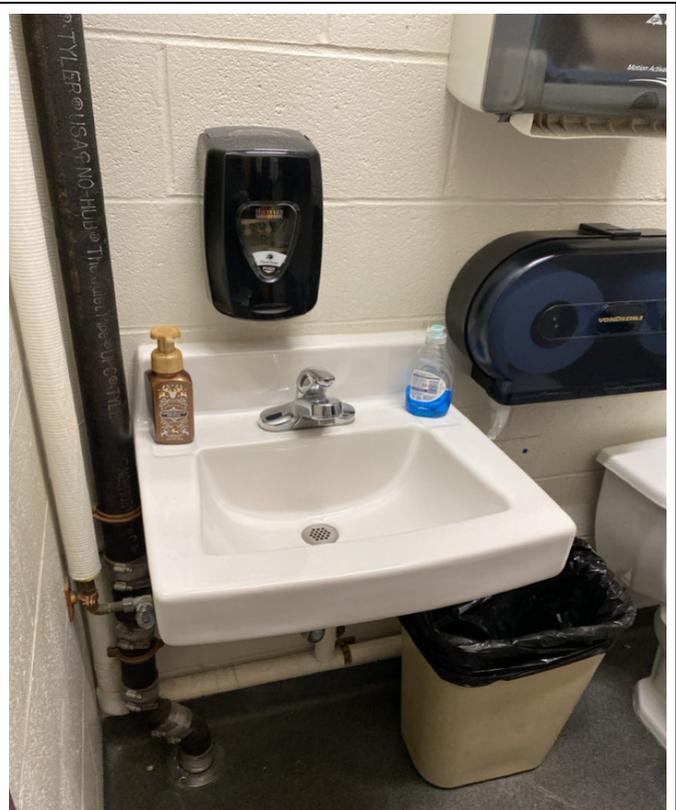

2/6/2024 - 1-46 - High School - Girls Locker Room-Coach's Office

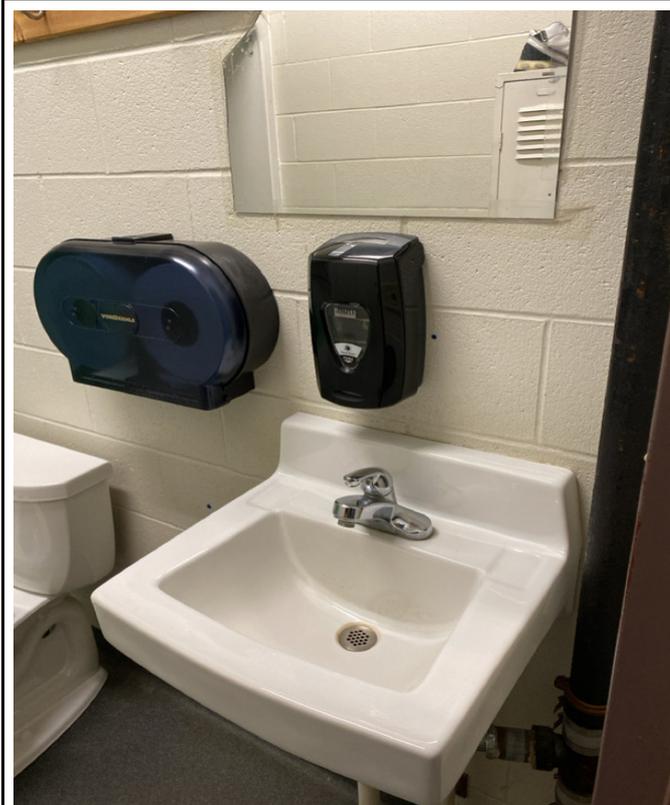

2/6/2024 - 1-47 - High School - Boys Locker Room-Coach's Office




2/6/2024 - 1-48 - High School - Concession Stand-Handwashing Sink



2/6/2024 - 1-49 - High School - Concession Stand-Three Bay Sink-Left



2/6/2024 - 1-50 - High School - Concession Stand-Three Bay Sink-Right

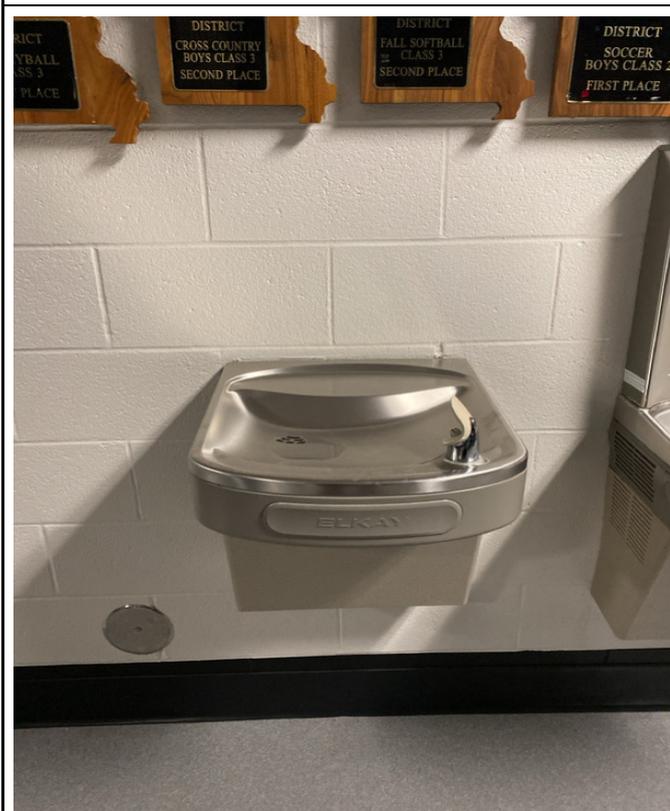

2/6/2024 - 1-51 - High School - Commons-Left



2/6/2024 - 1-52 - High School - Kitchen-North Sink



2/6/2024 - 1-53 - High School - Kitchen-Northwest Handwashing Sink



2/6/2024 - 1-54 - High School - Kitchen-Four Bay Sink-Right



2/6/2024 - 1-55 - High School - Kitchen-Four Bay Sink-Middle



2/6/2024 - 1-56 - High School - Kitchen-Four Bay Sink-Left



2/6/2024 - 1-57 - High School - Kitchen-
Handwashing by Four Bay Sink



2/6/2024 - 1-58 - High School - Kitchen-North
Middle Sink



2/6/2024 - 1-59 - High School - Kitchen-South
Middle Sink



2/6/2024 - 1-60 - High School - Kitchen-Southwest
Sink-Left



2/6/2024 - 1-61 - High School - Kitchen-Southwest Middle Sink



2/6/2024 - 1-62 - High School - Kitchen-Southwest Right Sink



2/6/2024 - 1-63 - High School - Kitchen



2/6/2024 - 1-64 - High School - Kitchen



2/6/2024 - 1-65 - High School - Kitchen



2/6/2024 - 1-66 - High School - Kitchen-Serving Area



2/6/2024 - 1-67 - High School - Kitchen-Food Warmer-East




2/6/2024 - 1-68 - High School - Kitchen-Food Warmer-West




2/6/2024 - 1-69 - High School - Instrumental Music Office



2/6/2024 - 1-70 - High School - Instrumental Music Room

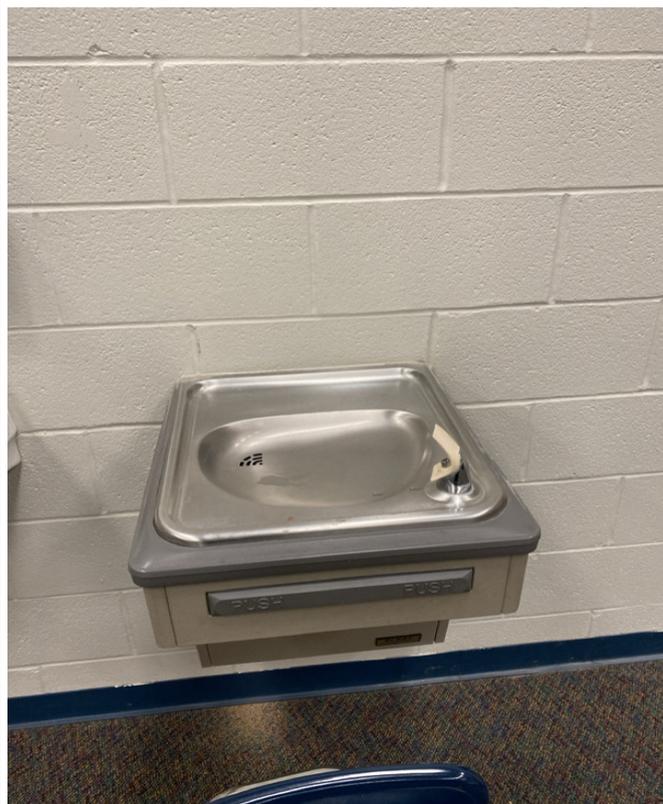

2/6/2024 - 1-71 - High School - Instrumental Music Room

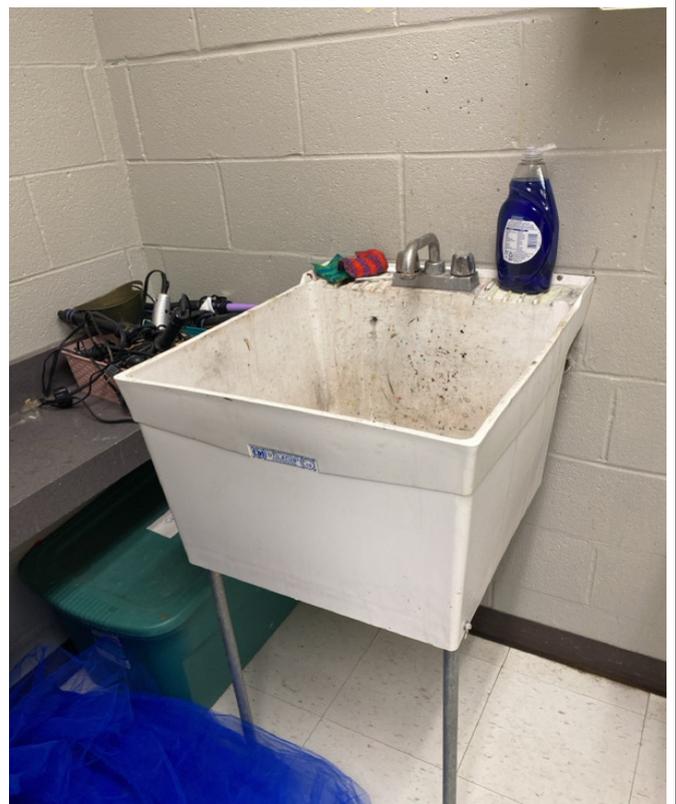


2/6/2024 - 1-72 - High School - Girls Dressing Room-Left



2/6/2024 - 1-73 - High School - Girls Dressing Room-Right



2/6/2024 - 1-74 - High School - Girls Dressing Room-Restroom

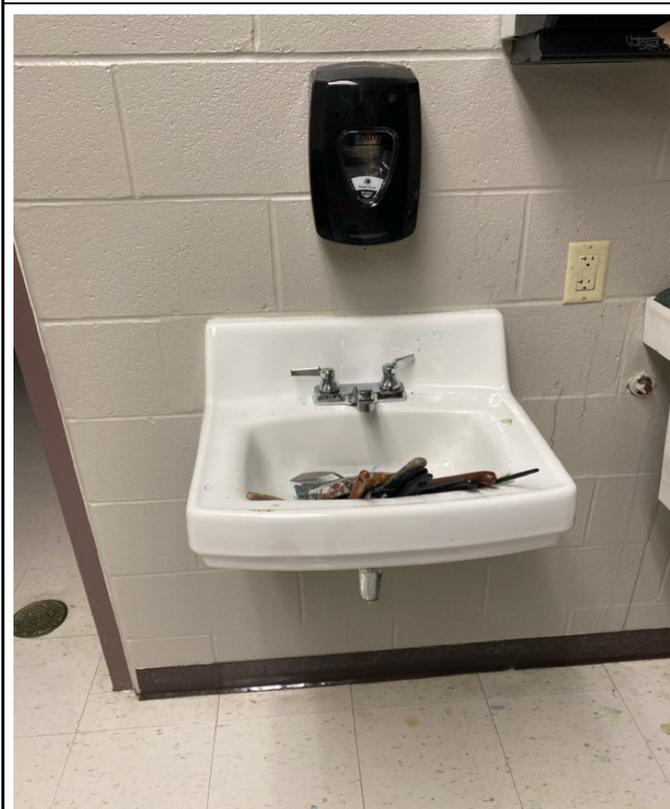

2/6/2024 - 1-75 - High School - Boys Dressing Room-Left



2/6/2024 - 1-76 - High School - Boys Dressing Room-Right



2/6/2024 - 1-77 - High School - Boys Dressing Room-Restroom




2/6/2024 - 1-78 - High School - Vocal Music Room



2/6/2024 - 1-79 - High School - Room 001 Lab-Northwest Sink



2/6/2024 - 1-80 - High School - Room 001 Lab-Northeast Sink

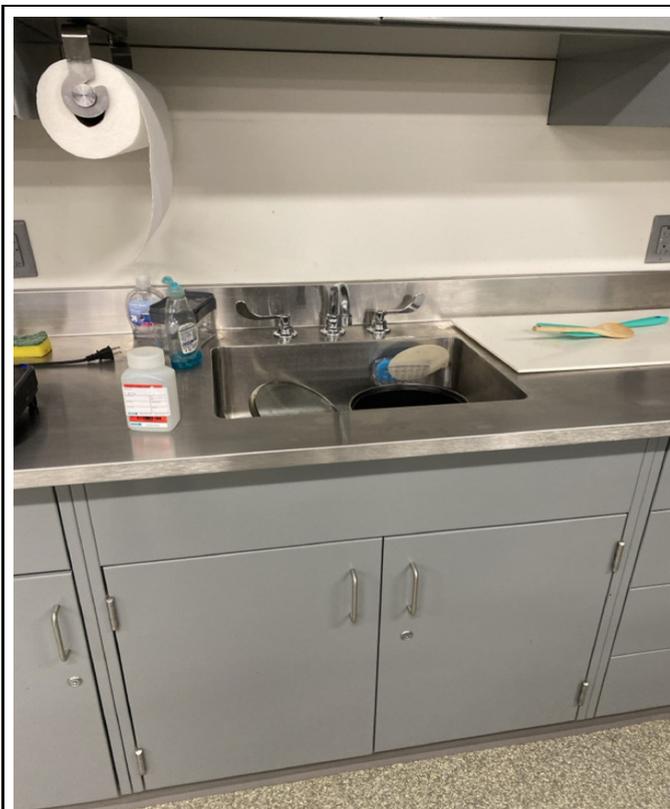


2/6/2024 - 1-81 - High School - Room 001 Lab- Southeast Sink



2/6/2024 - 1-82 - High School - Room 001 Lab- South Wall-Left Sink



2/6/2024 - 1-83 - High School - Room 001 Lab- South Wall-Right Sink

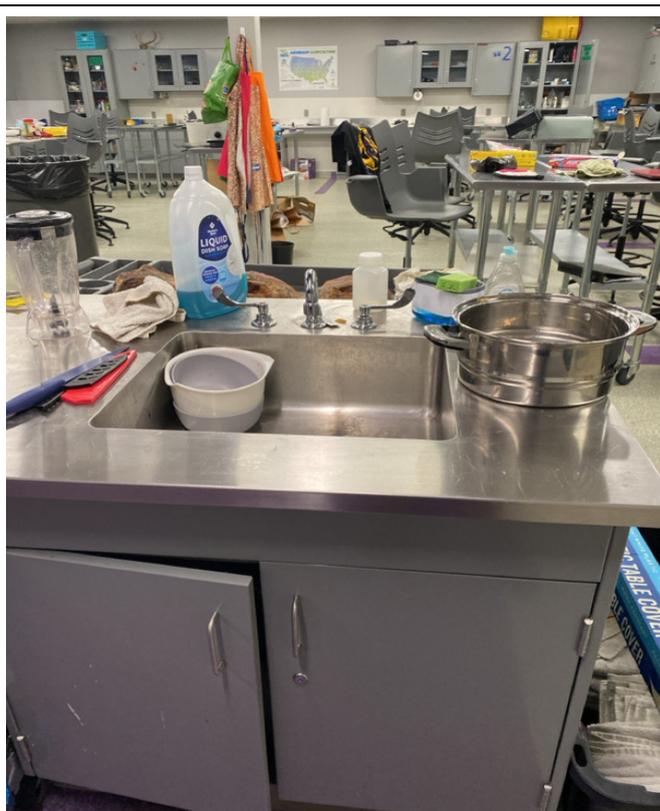

2/6/2024 - 1-84 - High School - Room 001 Lab- Teacher's Desk



2/6/2024 - 1-85 - High School - Room 001-Girls Restroom



2/6/2024 - 1-87 - High School - Outside Boys Restroom



2/6/2024 - 1-88 - High School - Room 002-Southeast Sink



2/6/2024 - 1-89 - High School - Room 002-East Middle Sink



2/6/2024 - 1-90 - High School - Room 002-
Northeast Sink




2/6/2024 - 1-91 - High School - Room 002-
Northwest Sink




2/6/2024 - 1-92 - High School - Room 002-West
Middle Sink



2/6/2024 - 1-93 - High School - Room 002-
Southwest Sink

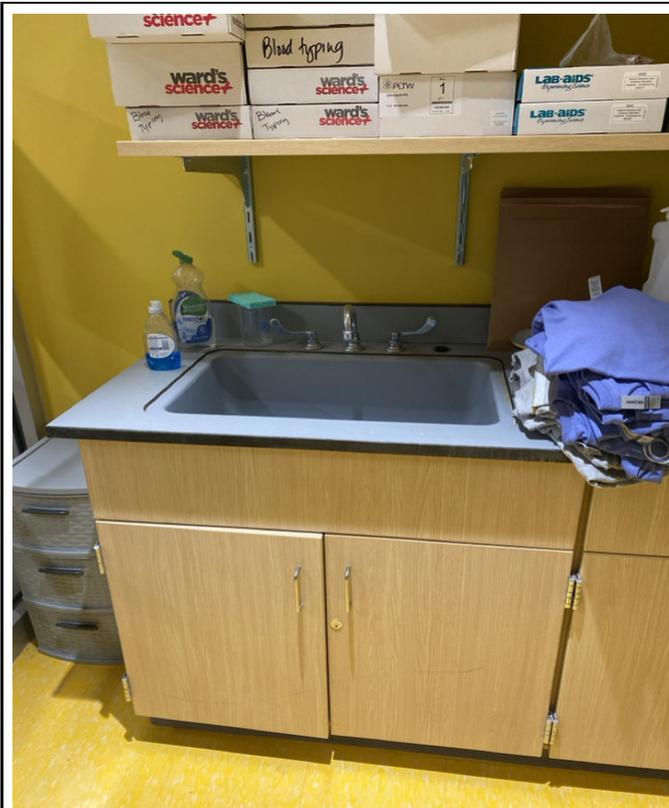

2/6/2024 - 1-94 - High School - Room 002-
Storage Room-Left

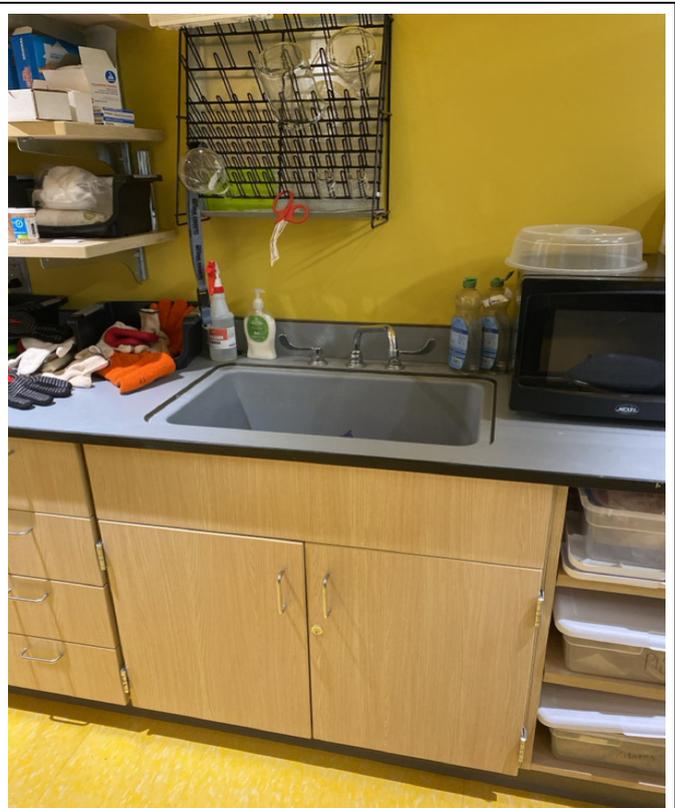

2/6/2024 - 1-95 - High School - Room 002-
Storage Room-Right



2/6/2024 - 1-96 - High School - Room 003 Lab



2/6/2024 - 1-97 - High School - Hall by the Dock-
Out of Order



2/6/2024 - 1-98 - High School - Room 004



2/6/2024 - 1-99 - High School - Metal Shop



2/6/2024 - 1-100 - High School - Metal Shop-
Men's Restroom



2/6/2024 - 1-101 - High School - Metal Shop-
Women's Restroom



2/6/2024 - 1-102 - High School - Wrestling Room-
Left



2/6/2024 - 1-103 - High School - Commons-Right


Appendix E

Source Identification Diagram

ASP was provided sample locations by
Pleasant Hill School District

BASEMENT FLOOR

~~HS~~

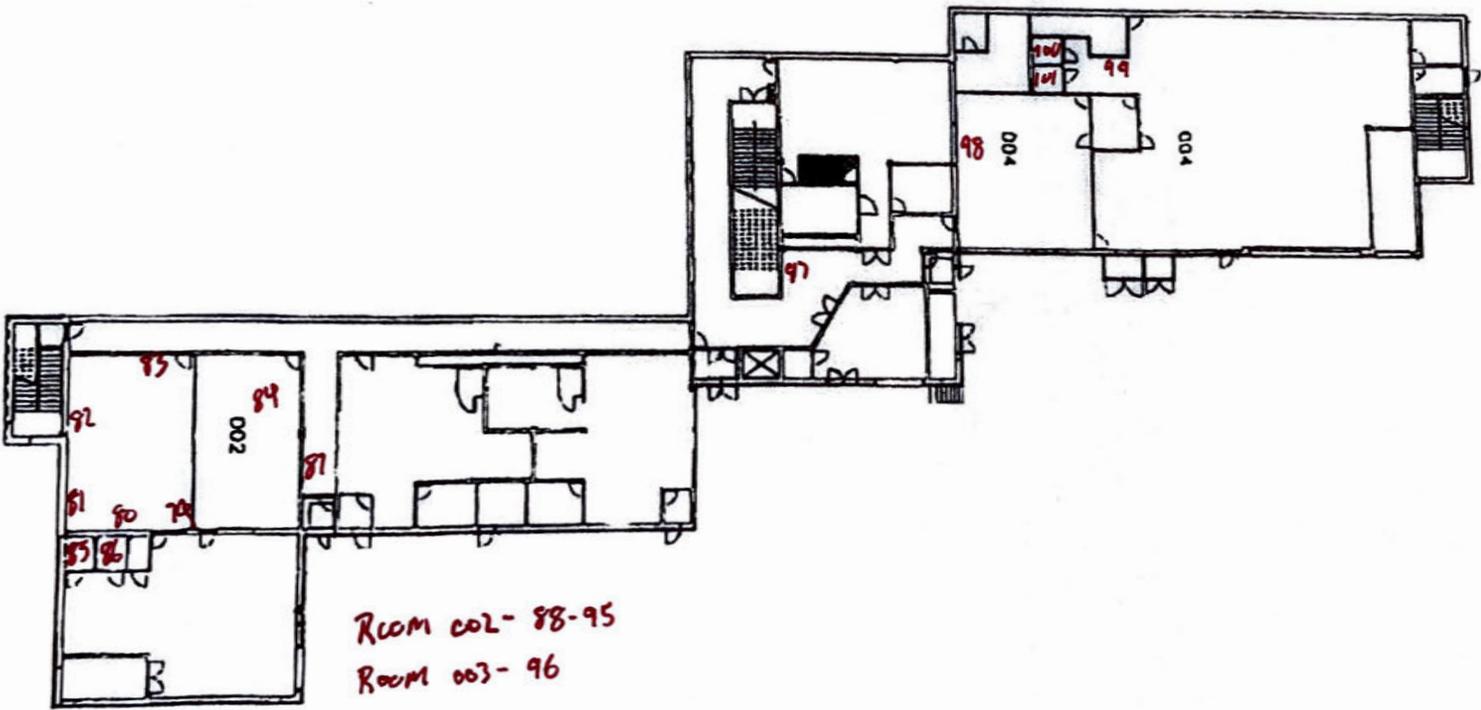

Server Room

Switch Closet


ROOM 002- 88-95
ROOM 003- 96

FIRST FLOOR

AS

Server Room

Switch Closet

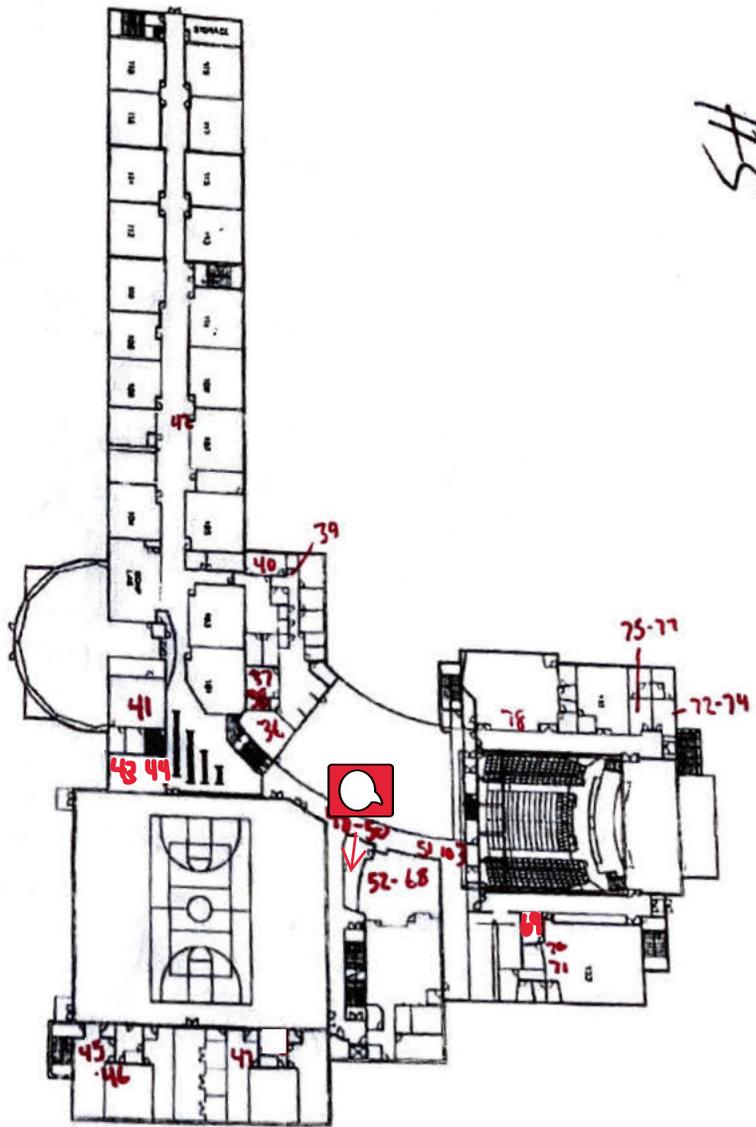

SA

SECOND FLOOR

HS

